




**Walker® Infloor Systems**  
**Walkerduct® Junction Box**  
**Side Rail Extension**  
**INSTALLATION INSTRUCTIONS**

Walker® electrical systems conform to and should be properly grounded in compliance with requirements of the current National Electrical Code or codes administered by local authorities.



All electrical products may present a possible shock or fire hazard if improperly installed or used. Walker electrical products may bear the mark as UL Listed and/or Classified and should be installed in conformance with current local and/or the National Electrical Code.

Remove tape, cover plate assembly, aluminum frame (if applicable), internal leveling screws, existing side walls, and support bolts (if applicable) from junction box before starting assembly.

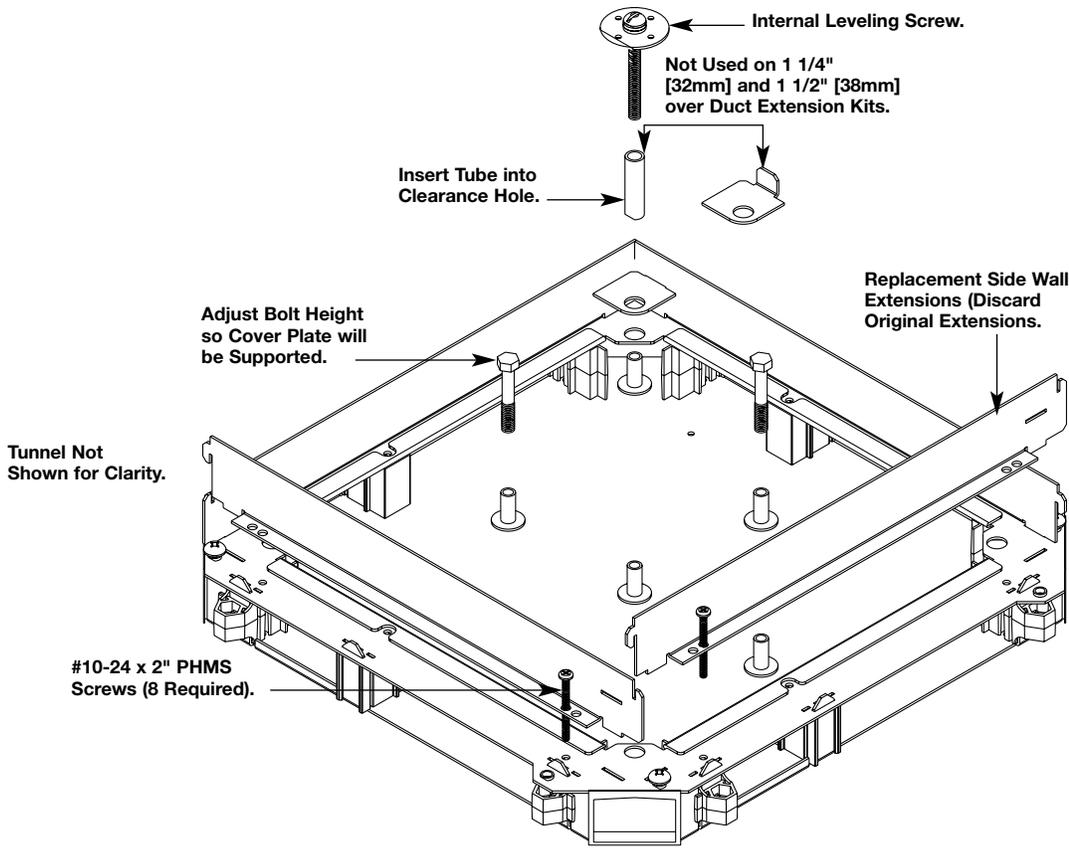

**Round Cover Plate Junction Boxes Only.**

**Square Cover Plate Junction Boxes Only.**

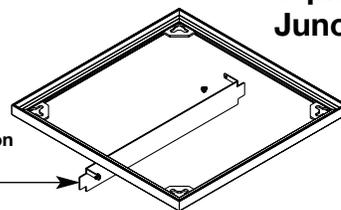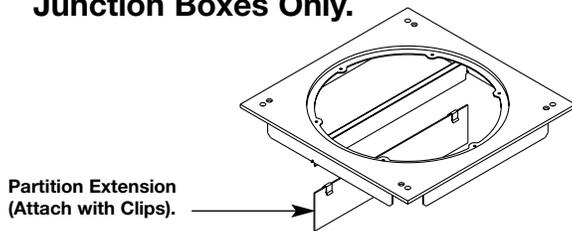

Reassemble Junction Box Components and Install New Tape Around Cover Plate.