



Wiremold® Electrical Systems conform to and should be installed and properly grounded in compliance with requirements of the current National Electrical Code, Canadian Electrical Code or codes administered by local authorities. All electrical products may represent possible shock or fire hazard if improperly installed or used. Wiremold electrical products are UL Listed, made for interior use only, and should be installed in conformance with current local and/or the National Electrical Code.



# TableSource™ WorkSurface Modules

## INSTALLATION INSTRUCTIONS

### TS SERIES WHIP-ENDED MODULES



**NOTE:** Whip removed from all views for clarity.

#### Mounting Flange:

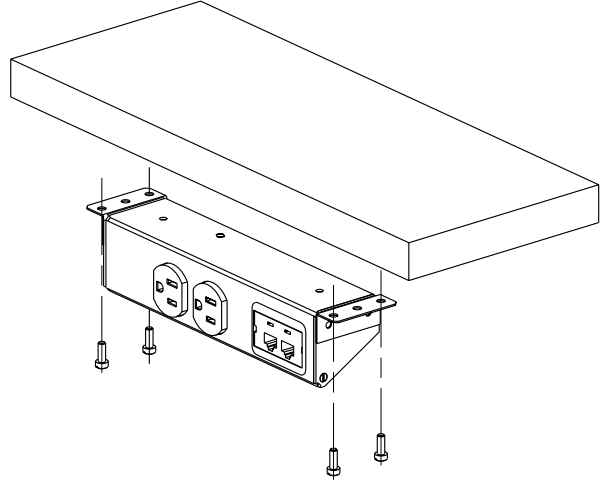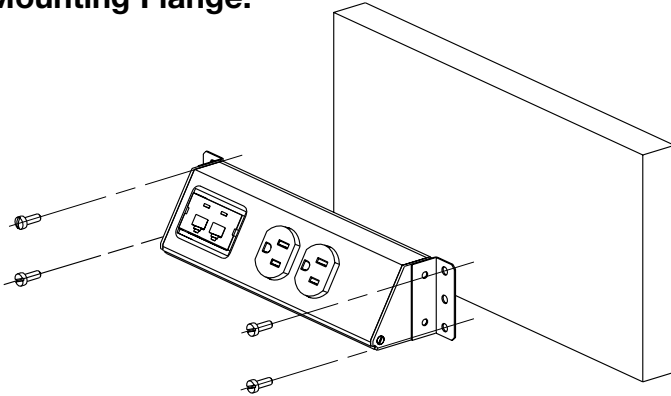

**NOTE:** Use No. 8 (5/16" [7.9mm] head size) round head fastener or equivalent to secure mounting flange onto mounting surface.

#### Mounting Studs:

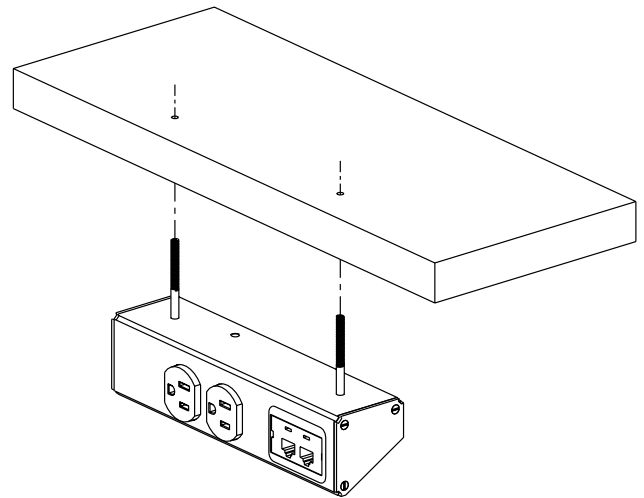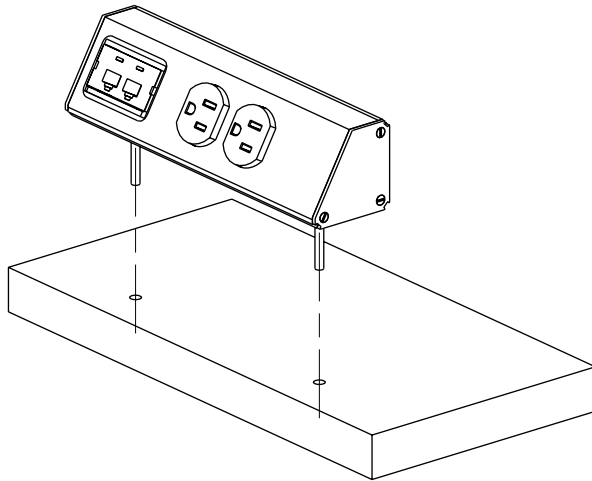

**NOTE:** Use No. 10-32 nut and washer to secure mounting studs into mating holes in mounting surface.

Attach flexible metal conduit whip to junction box using approved 3/8" flexible metal conduit fitting.



#### The Wiremold Company

U.S. and International:

60 Woodlawn Street • West Hartford, CT 06110

1-800-621-0049 • FAX 860-232-2062 • Outside U.S. 860-233-6251

Canada:

850 Gartshore Street • Fergus, Ontario N1M 2W8

1-800-741-7957 • FAX 519-843-5980

